

N 5.52%

1GW 3GW  
 N TOPCon  
 N P  
 7 15 8  
 N TOPCon PERC  
 287.4MW 2023 6  
 15  
 5.52%

Tiger Neo N  
 2023 7 15 -8  
 15  
 P PERC  
 5.52%  
 N TOPCon

N29°56'50.75" E100°37'1.94"


N TOPCon 4600m

4000m-4600m

6434.8MJ/m<sup>2</sup>

N TOPCon P

5.52%

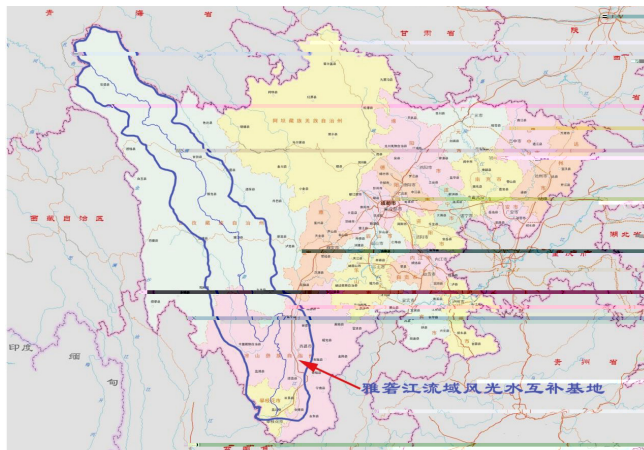

Tiger Neo

N  
 1%  
 N TOPCon  
 5.52%  
 P PERC  
 -0.29%/  
 P  
 2% N  
 20 -25

图1: 项目位置

74  
 149  
 26°  
 163  
 ± 45°  
 10.5  
 1.8  
 196kW  
 26  
 1.21  
 N TOPCon  
 1.15  
 P PERC

1%-1.5%  
 10  
 N  
 15%-20%  
 80%  
 P  
 N  
 0.4%  
 N TOPCon  
 IEC61215  
 UV+TC+HF  
 PVEL  
 PQP  
 N TOPCon  
 0.55%  
 DH2000  
 N TOPCon

	kWh	kWh/kw	
N 型 570Wp 双面	532046.15	137.55	5.52%
P 型 545Wp 双面	471000.17	130.35	

表1:N型和P型组件发电量及增益对比

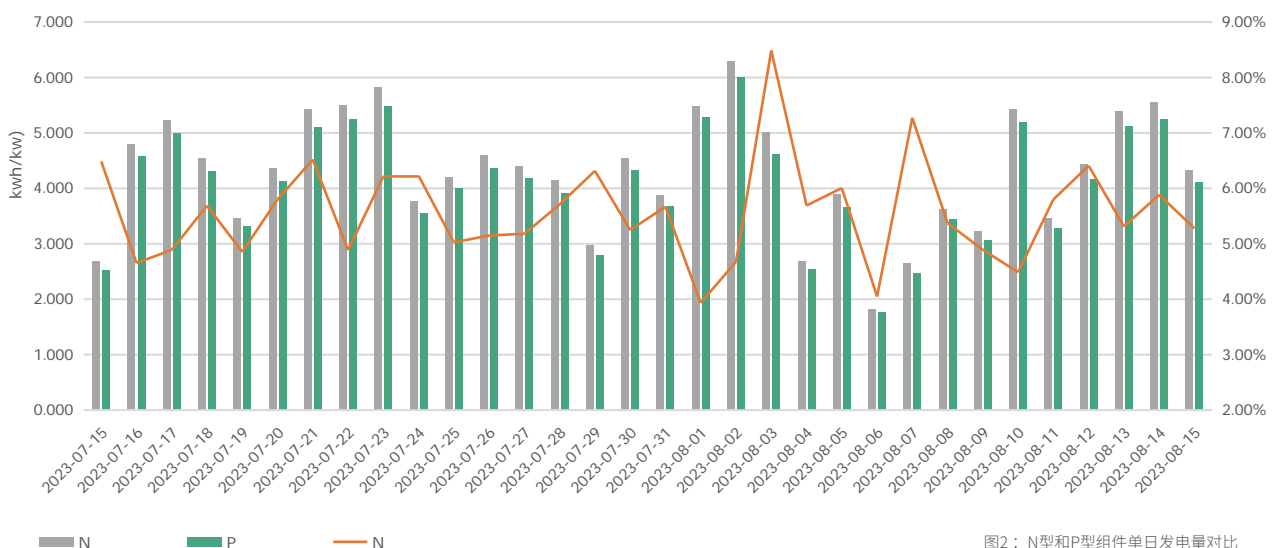


图2: N型和P型组件单日发电量对比